


PICV Packages

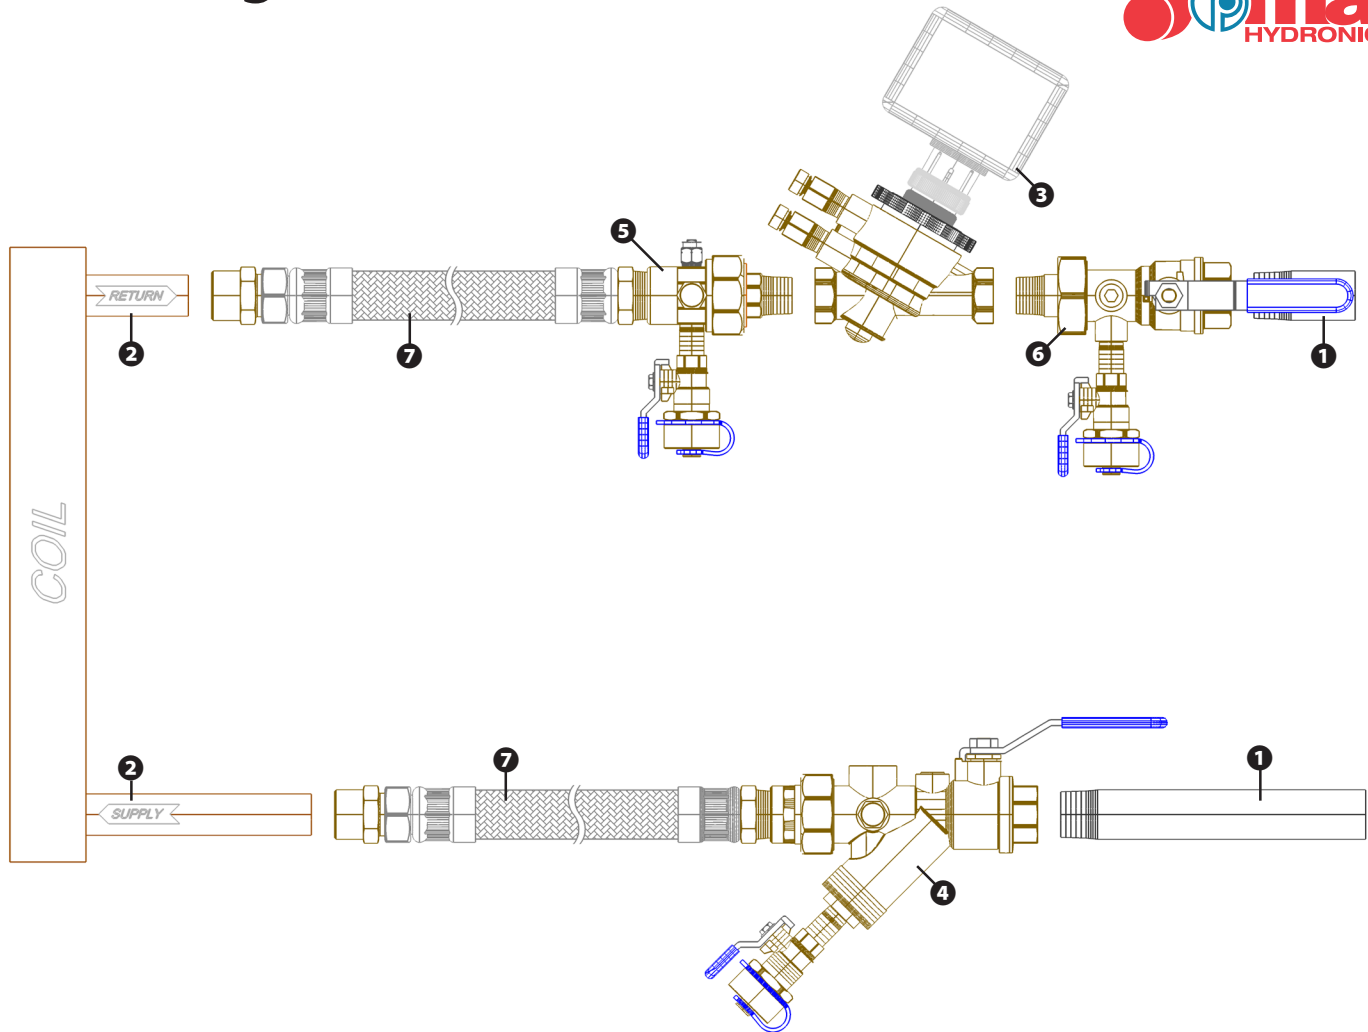

1 Run Out Pipe

Connection Type

- MNPT SWT Copper (Press)

2 Coil

Connection Type

- MNPT FNPT SWT

3 Actuator (24 VAC)

Fail Position

- Fail Safe Fail In Place

Signal

- On/Off 0-10VDC Floating

4 Stainer / Supply Side Valve

Type

- Terminator S Terminator Y Terminator N

PT Port

- Yes No Yes No

Drain / Blowdown (Terminator S requires two Drain / Blowdown valves for proper operation)

5 Union

PT Port

- Yes No

Drain / Blowdown

- Yes No

Air Vent

- N/A Manual
 Ball Valve Automatic w/Ball Valve

6 Return Side Valve

Type

- Terminator N Ball Valve

Drain / Blowdown (only specify if Terminator N is selected)

- Yes No

Air Vent (only specify if Terminator N is selected)

- N/A Manual
 Ball Valve Automatic w/Ball Valve

7 Flexible Hoses

Length (12" only available through 1", and 18" only available through 1-1/2")

- N/A 12" 18" 24" 36"

8 Extension for Insulation

- None All CW Only

Note: Information subject to change without notice. Prior to installation, please review the IO&M document.

